



Instructions for Model **SS-4 Water Alert**®


(Model XSS-4 when using Sensor Cable)



SS-4 Bottom View

PRINCIPLE OF OPERATION

Refer to Figure 1. The SS-4 is activated by liquid bridging the adjustable sensors (A & A). The unit can detect water film from zero height, (sensors turned out to make contact with the floor), to 1/8" height, (sensors turned all the way in). The units are factory adjusted to activate with 1/32" water film height which is satisfactory for most applications. The pads B1, B2, B3 provide a gap between the case and the surface to admit water under the unit for detection. **CAUTION:** If the pads are removed, the unit may form a seal with the surface and prohibit the sensors from detecting water. If desired, the self-adhesive pad feature may be used by peeling off the thin protective layer from each pad. The unit will remain in place when located on the mounting surface. Replacement pads are available from Dorlen at no charge.

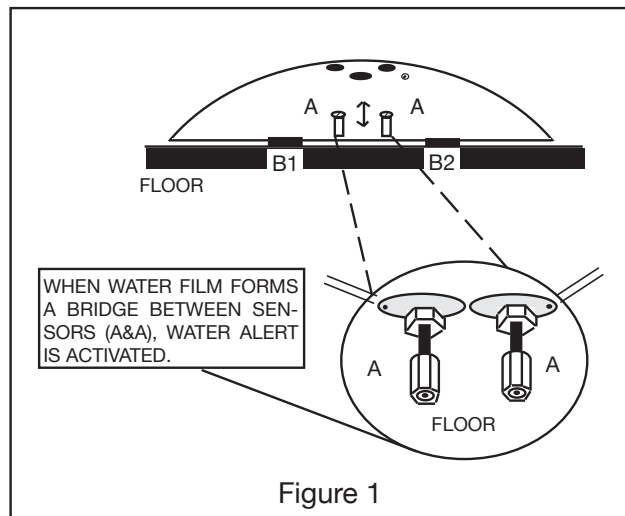

Powering options -

- 9v Alkaline Battery (Qty.2)
- PSW-3 Power Supply (Catalog Pg. 25)
- Voltage Module (Catalog Pg. 26)



Not For Explosive Environments!

If you have installation questions,
call **toll free** 1-800-533-6392

NOTE:

Although the two sensors (A & A) may be adjusted to make contact with the surface, it is recommended that a small gap be set between the sensors and the surface so undesired activation, caused by dampness or dirt film, does not occur.

1-19 M-9860

Instructions for Model **SS-4 Water Alert**®

SETUP AND ADJUSTMENTS

1. To adjust sensor height, hold straight edge across pads (B1 & B2). Turn sensors (A & A) out or until distance to straight edge equals the desired water detection level. See Figure 2.
2. Connect battery leads (E-E) to terminals of batteries (C-C). Then insert the batteries into retainer clips.
3. Wait ten seconds, then test unit by touching wet fingers to both sensors(A-A). **The Relay should transfer.**
4. Position Water Alert in desired location and retest it by placing wet fingers across the heads of the two screws on which sensors are mounted **The Relay should transfer.**
5. To reset the unit, simply remove it from water. If necessary, dry off the sensor area if it is excessively wet (if the unit was submerged).

BATTERIES

1. Two 9-volt alkaline batteries (NEDA size 1604A) are required.
2. The Alkaline batteries should be replaced once a year. If the unit is activated often, the batteries might need to be replaced sooner.
3. Whenever the batteries are replaced, it is a good practice to wipe clean the top surface of the Water Alert and its sensors.
4. A Dorlen Power Supply, such as the PSW-3, may be used in place of batteries. If so, follow the furnished instructions for wiring.



Not For Explosive Environments!

For Absolute Safety: DO NOT Connect line voltage to the relay contacts !

NOTE
Do Not Use Batteries
Other Than Alkaline!

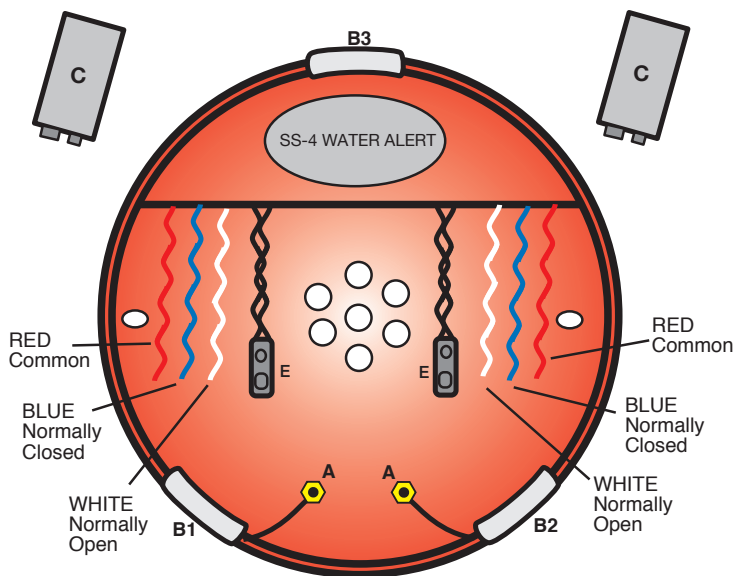


FIGURE 2
BOTTOM VIEW

INTERNAL ISOLATED RELAY CONTACTS.
DPDT - (2-Form C)
28VDC, 24VAC RATED @ 1 AMP.

CONTACT RATINGS:

1. Resistive - (a) 10,000,000 operations (typical) at low level.
(b) 1,000,000 operations min. at 0.5 amp/28VDC
(c) 100,000 operations min. at 1.0 amp/28VDC.
2. Inductive - 100,000 operations min. @ 200 ma. 320 mH, 28VDC.
3. Lamp - 100,000 operations min. @ 100 mADC, 28VDC.

OVERLOAD: 2 AMPS AT 28VDC.

CONTACT RESISTANCE:

- 0.1 ohm max. before life
- 0.2 ohm max. after life

(At max. rated current, measured 1/8" from header)

For controlling Voltage higher than 28vdc, contact Dorlen for information on the Model PR-WM Power Relay.



DORLEN Products Inc.

6615 West Layton Avenue, Milwaukee, WI. 53220

Phone: 414-282-4840 Fax: 414-282-5670 E-Mail: Office@dorleninc.com

www.waternalert.com